

SE-WWUHT SERIES

SE-WWUHT-50

Water-to-water single-cycle heat pump delivering pressurised hot water to 125 °C. R245fa, three-phase.
Both sides are water — there is no air coil and no fan.

www.sunnivaencon.com
+91 93213 65103
sales@sunnivaencon.com



HEATING CAPACITY

49.7 kW

At T1 · Rated duty

PEAK COP

2.99

At T1 · Rated duty

MAX WATER TEMP

125 °C

Rated outlet

COOLING CAPACITY

32.9 kW

Simultaneous, at the rated duty

Performance

Rated output at each test condition

T1 Rated duty

Heating capacity	49.7 kW
Power input	16.6 kW
COP	2.99
Water flow	8.6 m³/hr

Technical specifications

SE-WWUHT-50

ELECTRICAL SUPPLY

Power supply	—	380–415 V / 50 Hz / 3 Ph
Rated input power	kW	16.6
Rated current	A	34.27

REFRIGERATION CIRCUIT

Compressor	—	Scroll (Xecom)
Number of compressors	Nos	1
Refrigerant	—	R245fa
Heat exchanger (condenser)	—	Brazed plate heat exchanger
Throttling device	—	Electronic expansion valve

WATER CIRCUIT

Maximum water temperature	°C	125
Water flow	m³/hr	8.6
Water pipe size	inch	R1-1/2
Rated pressure	bar	2

UNIT & ACOUSTICS

Dimensions (L × W × H)	mm	1550 × 780 × 850
Net weight	kg	400
Noise at 1 metre	dB(A)	≤ 62

TEST CONDITIONS

Rated duty — evaporator side in / out 60 / 55 °C, condenser side in / out 115 / 120 °C


INSTALLATION REQUIREMENT

Protection device and cable size are not published for this model. Confirm both with Sunniva before wiring — the rated current above is not sufficient to size them.

Maintain water flow of **8.6 m³/hr** through the unit.

Site installation schematic

How the source loop and the delivery loop connect on site

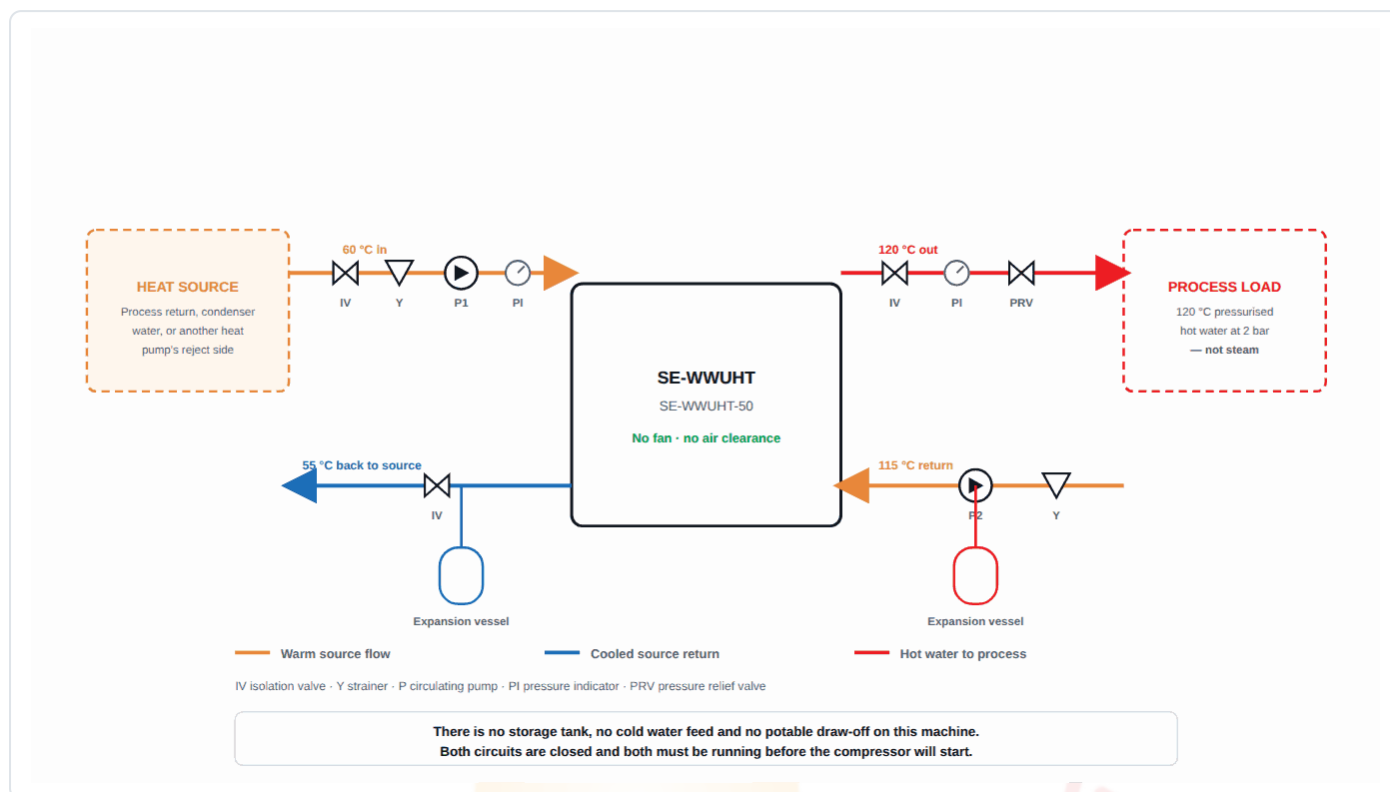

Indicative hookup only. Static head, draw pattern and local code may call for additional components — confirm the final scheme with Sunniva before ordering.

Selection & site preparation

Recommended sizing derived from this model's rated data

SYSTEM SIZING	
Source loop flow	8.6 m ³ /hr through the evaporator
Heat the source must give up	32.9 kW at the rated duty. This is not optional — if the source cannot release it, the machine makes less heat than the nameplate.
Minimum source temperature	Confirm with Sunniva. The R245fa compressor window starts at 22 °C evaporating; too cold a source puts the machine outside its permitted envelope, not merely off its rating.
Delivery loop flow	8.6 m ³ /hr through the condenser
Pipe size, both loops	R1-1/2
Line insulation	Both loops, rated for 125 °C on the delivery side

CIVIL & ELECTRICAL	
Unit footprint & dry weight	1550 × 780 mm · 400 kg
Plinth	1700 × 930 × 150 mm RCC, M20
Plinth level	100 mm above finished floor, ± 3 mm/m
Clearances	600 mm all round for service access. No air clearance is required — there is no fan.
Electrical	Not published for this model — confirm with Sunniva

Installation steps

Follow in order; commission before start-up

- Cast the plinth 1700 × 930 × 150 mm in M20 concrete, 100 mm above finished floor. Indoor or under cover; this machine does not need to see outdoor air.
- Set the unit on anti-vibration pads and level it to ± 3 mm/m.
- Pipe the **source loop** from the process return through an isolation valve, a Y-strainer and the circulating pump into the evaporator, and return it to the source. Size for 8.6 m³/hr.
- Pipe the **delivery loop** from the condenser to the process load and back, with an isolation valve, pressure indicator and a **pressure relief valve** on the flow. The circuit is pressurised — treat it as a hot water system, not a steam one.
- Fit an expansion vessel on each loop, sized to the loop volume and its working temperature. The delivery side runs at up to 125 °C.
- Fit a flow switch in each loop and interlock both to the compressor. **Neither loop may be dry when the machine starts.**
- Insulate both loops. The delivery side is a burn risk at 120 °C.
- Confirm the protection device and cable with Sunniva before wiring — they are not published for this model.
- On commissioning, prove the source can hold its temperature at full duty before signing off the heating output.

SUNNIVA ENCON LLP

Manufacturer & exporter of heat pumps since 2012

OFFICE

C-443, Oshiwara Industrial Centre
Premises CHS, New Link Road, Goregaon West, Mumbai

FACTORY


Tirupati Industrial Complex, Plot No. 41,
Sambhaji Nagar, Asangaon, Maharashtra 421601

CONTACT

+91 93213 65103
sales@sunnivaencon.com
www.sunnivaencon.com

Process & instrumentation diagram

Refrigeration circuit, instrumentation and water connections

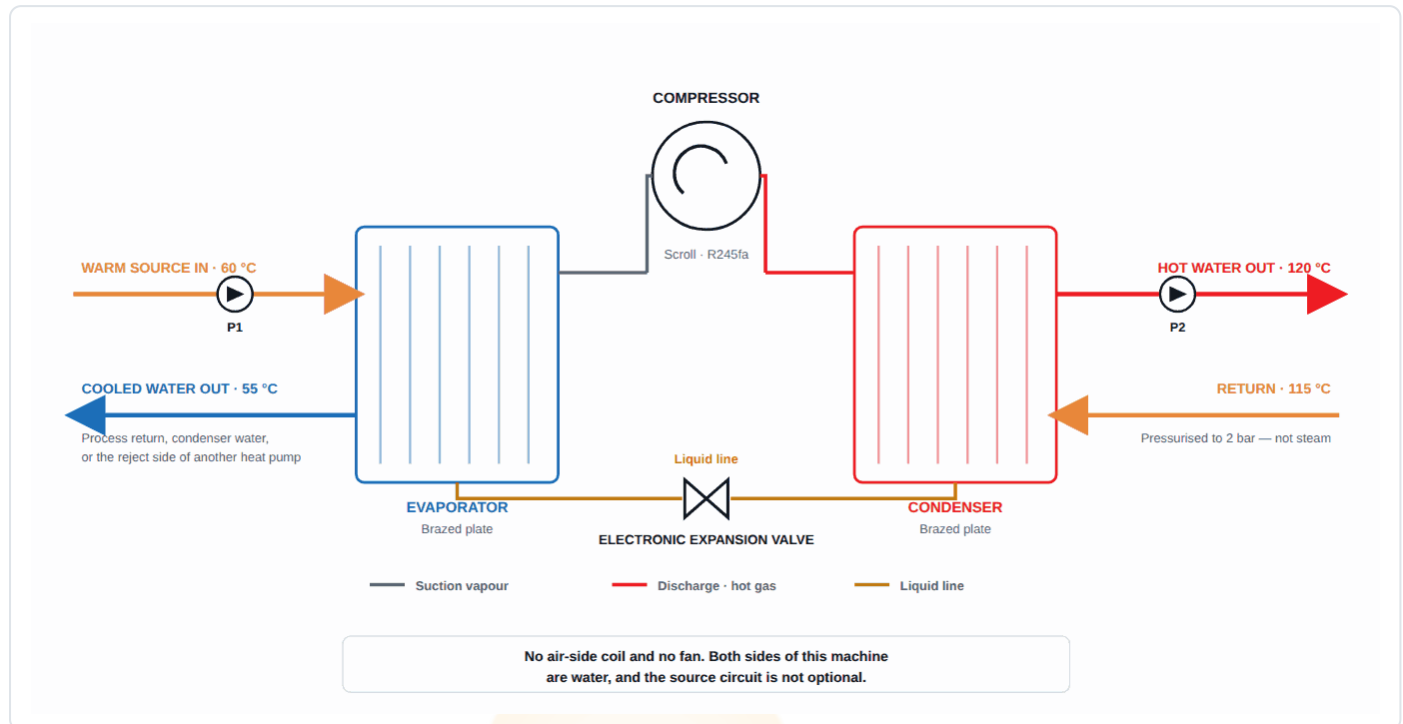

Schematic representation of the standard circuit — not to scale. Component arrangement may vary with build option.

Instrument schedule


Tags as marked on the diagram above

TAG	DEVICE	FUNCTION
TT 01	Compressor discharge temperature	Discharge superheat & high-temperature cut-out
TT 02	Compressor suction temperature	Suction superheat monitoring
TT 03	Water outlet temperature	Set-point control
TT 04	Water inlet temperature	Return water sensing, ΔT calculation
PS HIGH	High-pressure switch	Discharge over-pressure cut-out

TAG	DEVICE	FUNCTION
PS LOW	Low-pressure switch	Loss-of-charge / low-suction cut-out
PI HP	High-side pressure gauge	Discharge pressure indication
PI LP	Low-side pressure gauge	Suction pressure indication
FS 01	Water flow switch	Interlock — no-flow lockout

Cabinet reference drawing

Typical general arrangement — this model's own dimensions alongside

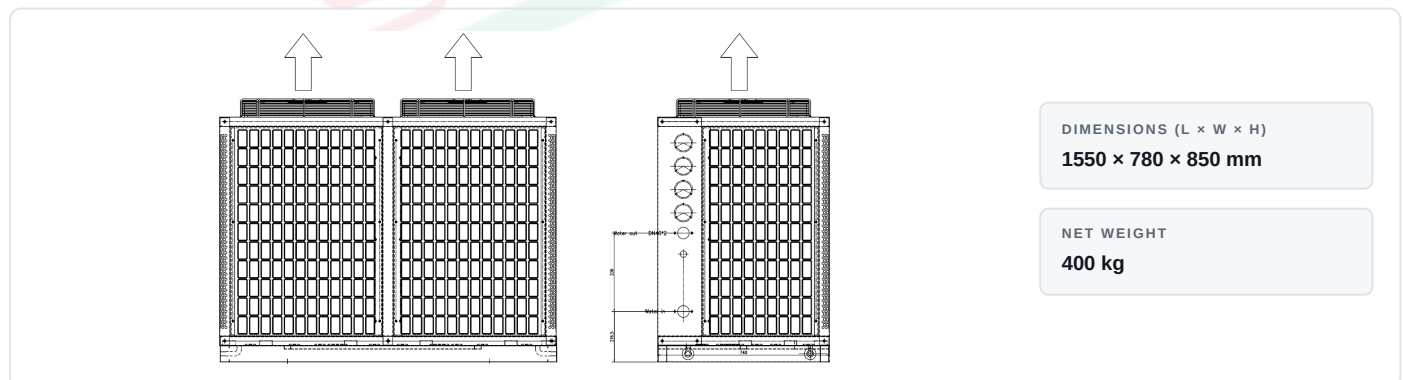

Reference arrangement only — Twin-compressor cabinet, vertical discharge. Dimensions printed on the drawing are indicative; the figures above and in the specification table are the ones that apply to this model.

SUNNIVA ENCON LLP

Manufacturer & exporter of heat pumps since 2012

OFFICE

C-443, Oshiwara Industrial Centre
Premises CHS, New Link Road, Goregaon West, Mumbai

FACTORY

Tirupati Industrial Complex, Plot No. 41,
Sambhaji Nagar, Asangaon, Maharashtra 421601

CONTACT


+91 93213 65103
sales@sunnivaencon.com
www.sunnivaencon.com

Operating envelope

The compressor's permitted window, in refrigeration terms

Operating envelope · R245fa circuit

Condensing against evaporating temperature — the compressor's permitted operating window

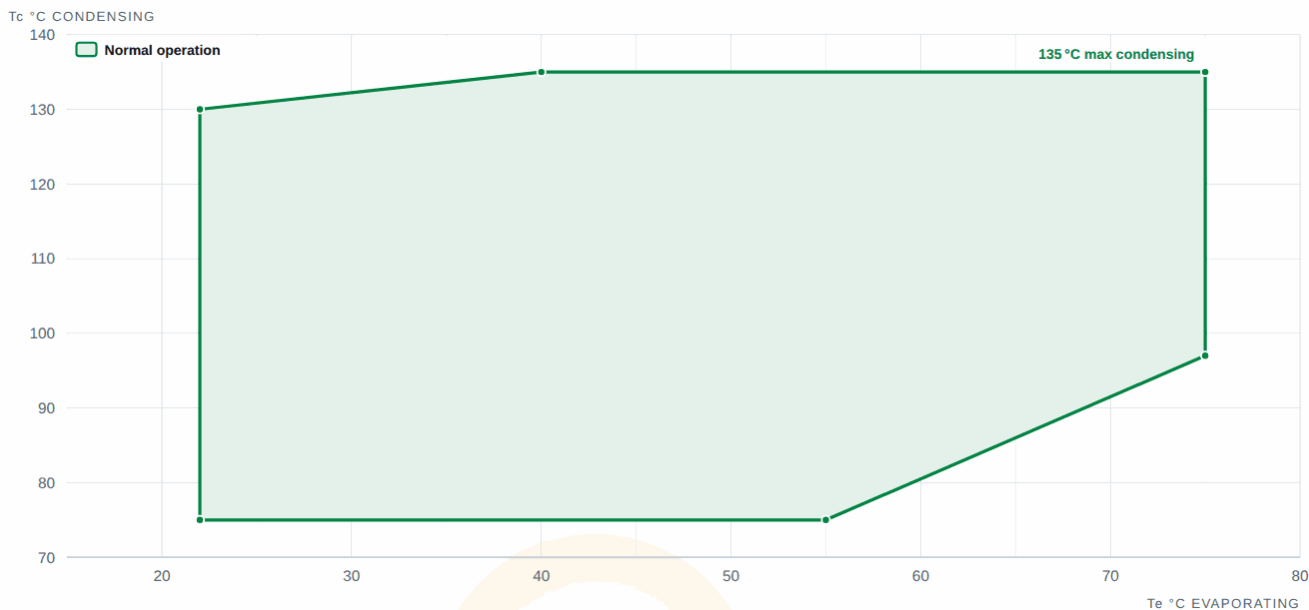

ENVELOPE LIMITS

Evaporating temperature T_e	22 °C to 75 °C
Condensing temperature T_c	75 °C to 135 °C
Peak condensing	135 °C highest hot-water temperature the circuit can reach
Transient operation	Not applicable the envelope above is the continuous operating window

READING THE ENVELOPE

T_e (evaporating) follows the source the unit draws heat from — the colder the air or source water, the lower T_e sits.

T_c (condensing) follows the water leaving the unit — asking for 80 °C hot water puts T_c near the top of the envelope.

A duty is valid only **inside the shaded area**. A cold source combined with very hot water pushes the point towards the top-left, which is exactly where the envelope closes in — that corner is the real limit on winter performance.

Representative envelope for the R245fa circuit, redrawn from the Xecom / Embraco Nidec scroll compressor selection guide, "Operating Envelop", XD*G panel. Envelope limits are broadly similar across compressor makes, so treat this as a representation of the circuit's operating window. Where a duty sits close to a boundary, confirm against the compressor fitted to the unit before finalising the design.

Documents & links

Scan with a phone camera to open

TALK TO SUNNIVA

Scan to open a WhatsApp chat



Sales

Enquiries & orders



Service

Breakdowns & spares

DOCUMENTATION

Scan to open the latest revision on sunnivaencon.com



User manual

Installation & operation



Service manual

Fault codes & servicing

CONNECT & REVIEW

Product videos and customer feedback



YouTube

Product videos



Review us

Rate us on Google

SUNNIVA ENCON LLP

Manufacturer & exporter of heat pumps since 2012

OFFICE

C-443, Oshiwara Industrial Centre
Premises CHS, New Link Road, Goregaon West, Mumbai

FACTORY

Tirupati Industrial Complex, Plot No. 41,
Sambhaji Nagar, Asangaon, Maharashtra 421601

CONTACT

+91 93213 65103
sales@sunnivaencon.com
www.sunnivaencon.com